


SELECTION GUIDE MANUFACTURING/WAREHOUSE HVAC fact sheet

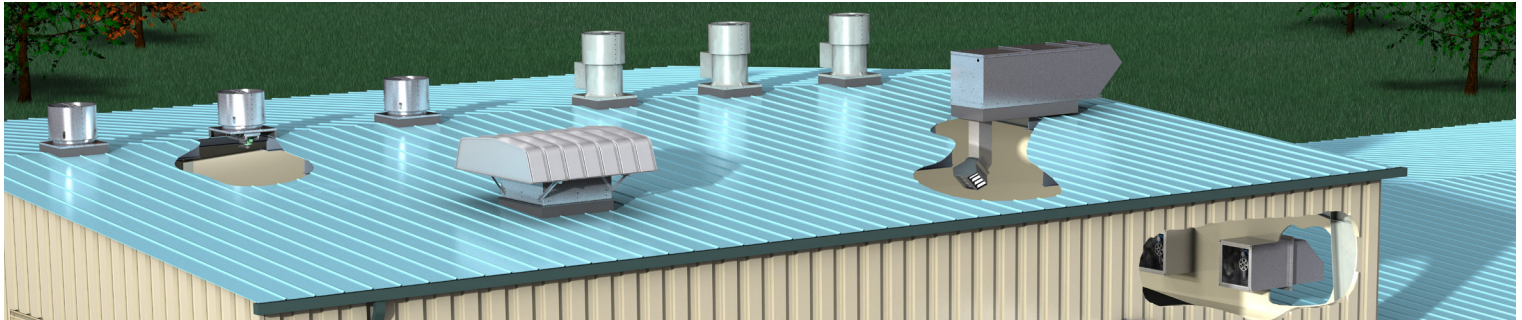

BASIC OVERVIEW

Ventilating a building simply replaces stale or foul air with clean, fresh air. Although the ventilation process is required for many different applications, the airflow fundamentals never change — *undesired air out, fresh air in.*

Key Variables That Change Based On Applications



Fan Model, Airflow Rate (CFM), Resistance to Airflow (Static Pressure, SP) and Sound Produced by the Fan (Sones)

AIR FLOW		APPLICATIONS							DRIVE TYPE		IMPELLER TYPE		INSTALLATION		PERFORMANCE			
EXHAUST	SUPPLY	GENERAL/CLEAN AIR	CONTAMINATED AIR	SPARK RESISTANT	SMOKE CONTROL (UL)	HIGH TEMP (ABOVE 200°F)	HAZARDOUS VAPORS OR PARTICLES		DIRECT	BELT	CENTRIFUGAL	PROPELLER/AXIAL	DUCTED	NON-DUCTED	MAXIMUM VOLUME (CFM)	MAXIMUM STATIC PRESSURE (IN. WG)	SONES @ 0.25" SP @ 5FT. (10,000 CFM)	COST/CFM

CHOOSING A FAN MODEL

Dayton






WALL-MOUNTED

Propeller Fan		X	X	X				X	X	X		X		X	69,692	0.75	22.9	\$
Centrifugal Exhaust Ventilator		X		X	X	X	X	X	X	X	X		X	X	14,727	2.00	18.6	\$\$

UTILITY BLOWERS

Centrifugal Utility Exhaust		X		X	X	X	X	X	X	X	X		X		13,516	5.00	26	\$\$\$
-----------------------------	---	---	--	---	---	---	---	---	---	---	---	--	---	--	--------	------	----	--------

ROOF-MOUNTED

Upblast Centrifugal Exhaust Ventilator		X		X	X	X		X	X	X	X		X	X	18,611	2.00	18	\$\$
Upblast Axial Exhaust Ventilator		X		X	X				X	X		X		X	64,326	0.75	17.2*	\$\$
Hooded Axial Fan		X	X	X						X		X		X	43,906	0.625	22.9	\$\$
Emergency Smoke Exhaust Ventilator		X		X	X		X	X		X		X		X	34,761	0.50	18.4*	\$\$\$
Downblast Ventilator		X	X	X		X		X	X	X	X	X	X	X	37,068	2.00	15.8	\$\$

* Sones @ 0.125 SP @ 5FT.



The Grainger Choice badge signals a broad selection of products that deliver quality and value, brought to you by Grainger.



OTHER FAN SELECTION CONSIDERATIONS

- Belt-Drive vs. Direct-Drive** — *Belt-drive* fans offer the ability to adjust fan speed for system balancing if necessary. They also offer more flexibility in speeds and motor selections. *Direct-drive* fans are often preferred for jobs where maintenance access is difficult. Maintenance costs are generally lower, since there are no belts or bearings to replace and no pulleys to adjust.
- Larger Fans vs. Smaller Fans** — Larger fans tend to turn slower and generate less sound, they also tend to have higher initial costs but lower operating costs. Smaller fans, with their higher speeds, have more stable performance curves, lower initial costs, higher sound levels, and higher operating costs.
- Low Sound vs. High Static Pressure** — Fans selected for high static pressures run at higher speeds resulting in higher sound levels. Conversely, in low pressure applications, fans generally run at lower speed producing lower sound levels.
- How Accessories Affect Static Pressure** — Accessories will restrict airflow and must be accounted for when calculating static pressure load. Refer to Static Pressure Guidelines table for more information. For propeller fans – dampers, guards and weatherhoods add very little to total system pressure. These can typically be specified with low pressure capabilities below 0.375" w.g.

SUGGESTED AIR CHANGES FOR INDOOR AIR QUALITY

AREA	MIN./CHG.	AREA	MIN./CHG.	AREA	MIN./CHG.
Attic	2-4	Foundry	1-5	Packing House	2-5
Barn	12-18	Garage	2-10	Plating Room	1-5
Boiler Room	1-3	Generator Room	2-5	Printing Plant	3-8
Cafeteria	3-5	Kitchen	1-5	Restroom	5-7
Corridors/Halls	6-20	Laundry	2-4	Store	3-7
Dairies	2-5	Machine Shop	3-6	Transfer Room	1-5
Dining Room	4-8	Meeting Room	3-10	Warehouse	3-1
Engine Room	1-3	Mill	3-8	CFM = $\frac{\text{Room Volume}}{\text{Min./Chg.}}$	
Factory	2-7	Office	2-8		


STATIC PRESSURE GUIDELINES

Non-Ducted	0.05" to 0.20"
Ducted	0.2" to 0.40" per 100 feet of duct (assuming duct air velocity falls within 1,000-1,800 feet per minute)
Fittings	0.08" per fitting (elbow, register, grill, damper, etc.)
Kitchen Hood Exhaust	0.625" to 1.50"

Static pressure is the resistance to airflow measured in inches of water gauge. It is an additive property in which each accessory, fitting, or length of ductwork adds to the total static pressure.

IMPORTANT: Static pressure requirements are significantly affected by the amount of make-up air supplied to an area. Insufficient make-up air will increase static pressure and reduce the amount of air that will be exhausted. Remember, for each cubic foot of air exhausted, one cubic foot of air must be supplied.

TYPICAL VENTILATION INSTALLATIONS

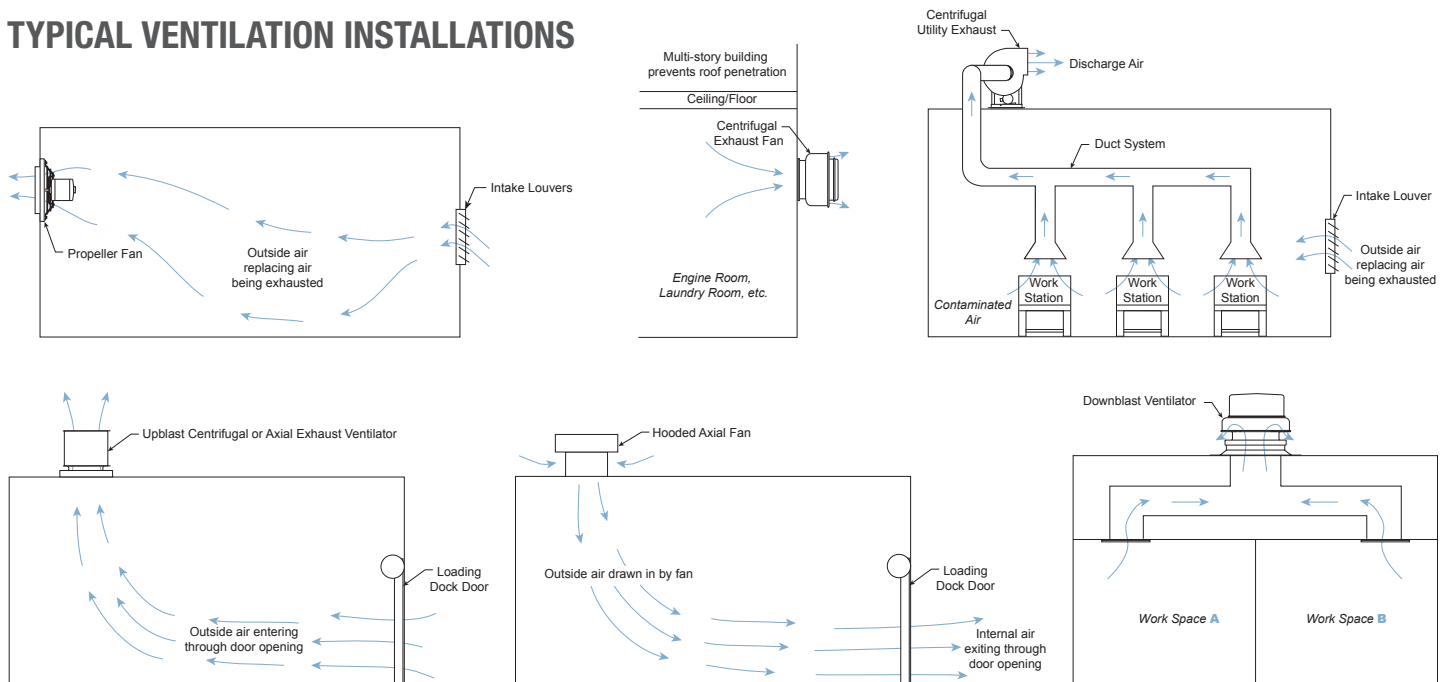

Call or visit your local branch or go to grainger.com/dayton for complete product line information.

Dayton®