



Stock No.
4YY25

Job Name:
Mark:

Submitted By:
Date:12/18/2025

Power Roof Ventilators

Axial Belt-Drive Upblast Exhaust Ventilator




Designed for use in industrial and commercial buildings such as warehouses, manufacturing facilities, foundries, and laboratories. Housing is constructed of heavy gauge galvanized steel. The windband is removable for easy inspection. Lifting lugs are provided.

- Maximum inlet air temperature: 120° F
- UL/cUL 705 Listed for Power Ventilators
- Air handling quality bearings meet minimum of L10-100,000 hours
- Regreaseable pillow block bearings




Dayton Electric Mfg. Co. certifies that the ventilators shown herein are licensed to bear the AMCA seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 211 and AMCA Publication 311 and comply with the requirements of the AMCA Certified Ratings Program.

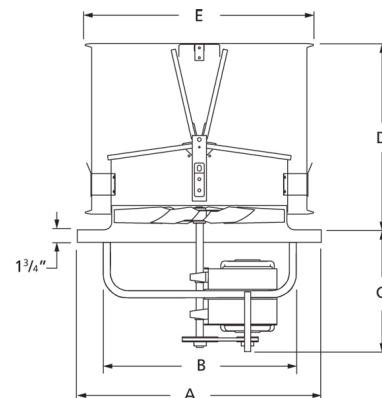

A	B	C	D	E
44 3/4 in	38 1/2 in	17 1/2 in	33 in	43 1/2 in

Performance Characteristics

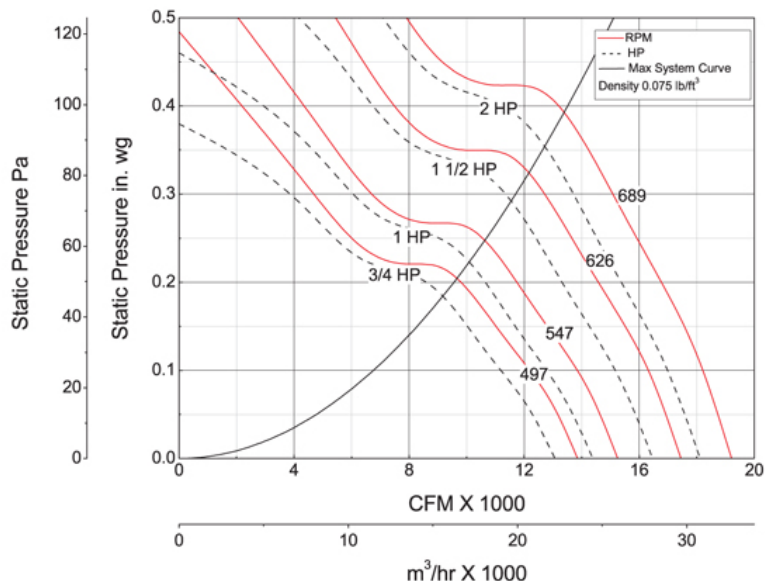

Construction Features

Impeller Diameter (Typ.)	36 in
Impeller Type	Propeller
Impeller Material	Steel
Number of Blades	5
Max Inlet Temp	120 °F
Bearing Type	Regreaseable Pillow Block
Drive Package Description	Drives By Others
Warranty Length	1 Year

Air & Sound Performance

Motor HP	Max BHP	Fan RPM	CFM @	0.000" SP	0.125" SP	0.250" SP	0.375" SP
3/4	0.90	497	CFM	13,858	11,600	—	—
			Sones	17.3	16.2	—	—
1	1.20	547	CFM	15,252	13,326	—	—
			Sones	20.0	19.2	—	—
1 1/2	1.80	626	CFM	17,455	15,884	13,659	—
			Sones	25.0	24.0	22.0	—
2	2.40	689	CFM	19,212	17,866	15,917	13,659
			Sones	29.0	29.0	27.0	26.0

Performance certified is for installation type A: Free inlet, Free outlet. Power rating (BHP) does not include transmission losses. Performance ratings do not include the effects of appurtenances (accessories). The sound ratings shown are loudness values in fan sones at 5 ft. (1.5 m) in a hemispherical free field calculated per AMCA Standard 301. Values shown are for installation type A: Free inlet hemispherical sone levels.